



NOTES/DESCRIPTION	
1	WALL MOUNTED PANEL
2	ANCHOR BOLT M10 x 100
3	RAWL PLUG & BOLT
4	BOLT & NUT WITH 1-SPRING WASHER & 2-FLAT WASHERS
5	MOUNTING CHANNEL (C-100x100x5mm)




ISOMETRIC VIEW OF
METALLIC CLAMP

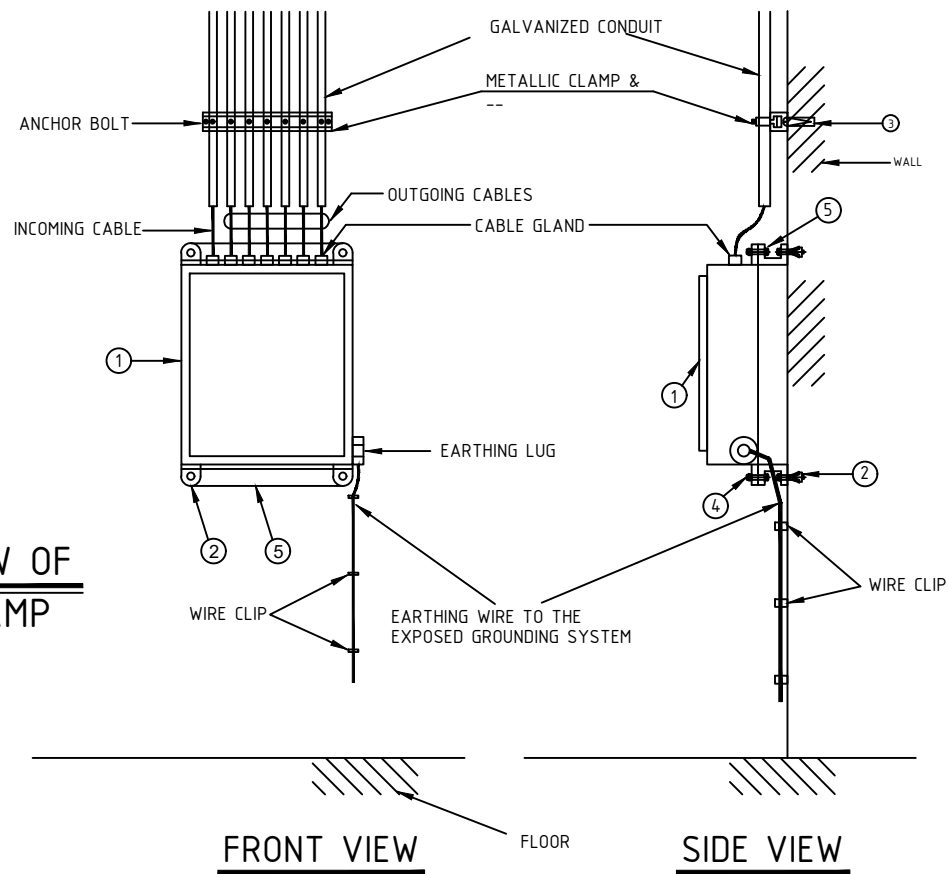

INSTALLATION DETAIL WALL MOUNTED PANEL

TITLE: BAGGED GOOD WAREHOUSE 2						
SCALE: AS SHOWN	DESIGNED					
DATE: 1405-06-09	CHECKED 1	S-HOSSEINI				
REF.:	CHECKED 2	-				
DRG.No.:	FINAL CHECK	N-ABBASI				
DRAWN: S-HOSSEINI	REVISIONS	A	B	C	1	2
		3	4	5	6	7
FILE CODE:						

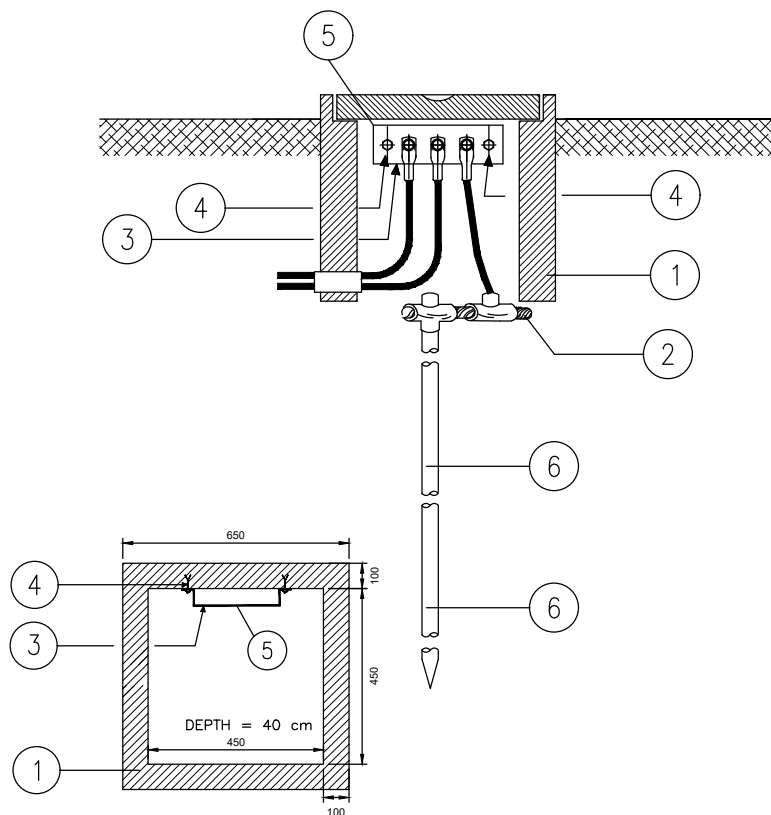


DESCRIPTION



- | | |
|---|--|
| 1 | GROUNDING PIT |
| 2 | SOFT COPPER CONDUCTOR 50 Sqmm. |
| 3 | COPPER PLATE FOR GROUNDING |
| 4 | EXPANSION BOLT M10x60 |
| 5 | COPPER BAR 40x300x5mm |
| 6 | EARTHING ROD $\phi=1.9\text{Cm}$, $L=1.5\text{m}$
(TOTAL OF ROD LENGTH=3m) |

TITLE: BAGGED GOOD WAREHOUSE 2						
SCALE: AS SHOWN	DESIGNED					
DATE: 1405-06-09	CHECKED 1	S-HOSSEINI				
REF.:	CHECKED 2	-				
DRG.No.:	FINAL CHECK	N-ABBASI				
DRAWN: S-HOSSEINI	REVISIONS	A 3	B 4	C 5	1 6	2 7
FILE CODE:						

ROD-PIT FOR INSPECTION AND CONNECTION




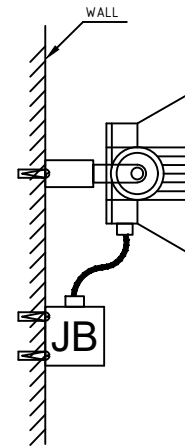


FLOOD LIGHTING
WALL MOUNTED

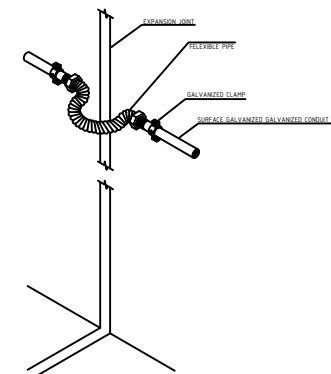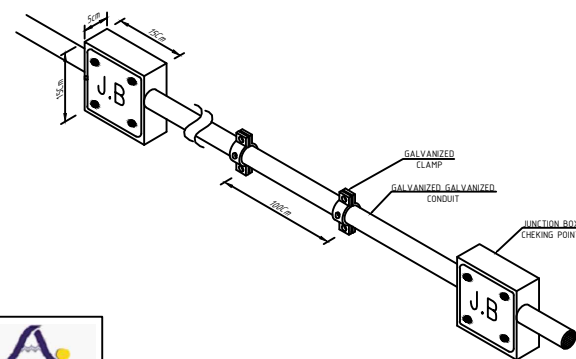

INSTALLATION DETAIL HALL LIGHTING SECTION

TITLE: BAGGED GOOD WAREHOUSE 2						
SCALE: AS SHOWN	DESIGNED					
DATE: 1405-06-09	CHECKED 1	S-HOSSEINI				
REF.:	CHECKED 2	-				
DRG.No.:	FINAL CHECK	N-ABBASI				
DRAWN: S-HOSSEINI	REVISIONS	A	B	C	1	2
		3	4	5	6	7
FILE CODE:						

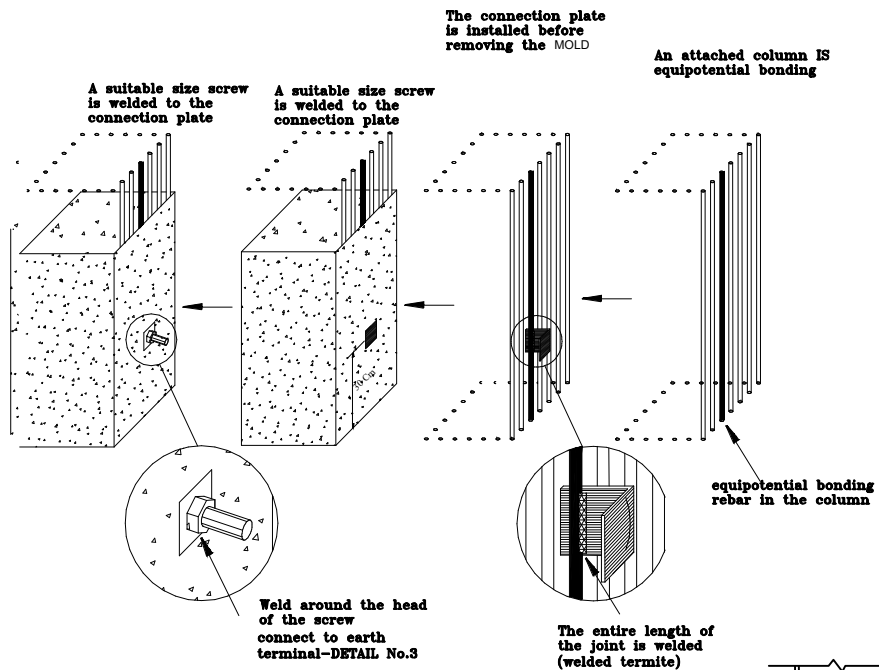


Unilateral welding	Bilateral welding	Armature type
3d	6d	AI
4d	8d	AII
5d	10d	AIII

d-Rebar diameter
AI-Rebar Simple type
AII, AIII-Ribbed type armature







TITLE: BAGGED GOOD WAREHOUSE 2								
SCALE:	AS SHOWN	DESIGNED						
DATE:	1405-06-09	CHECKED 1		S-HOSSEINI				
REF.:		CHECKED 2		-				
DRG.No.:		FINAL CHECK		N-ABBASI				
DRAWN:	S-HOSSEINI	REVISIONS		A	B	C	1	2
				3	4	5	6	7
FILE CODE:								

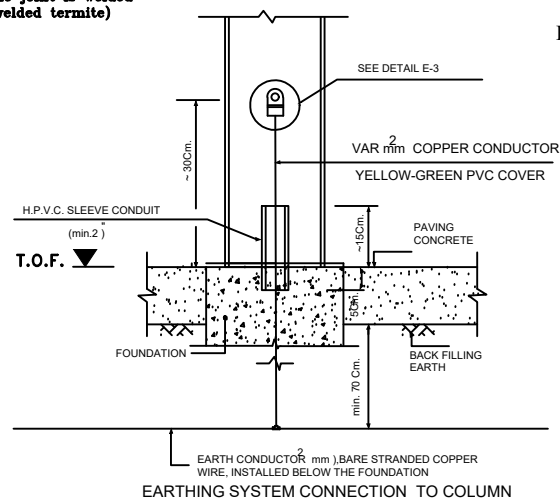


Dim. in cm.


Not to scale

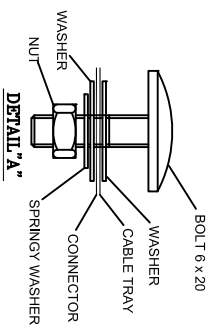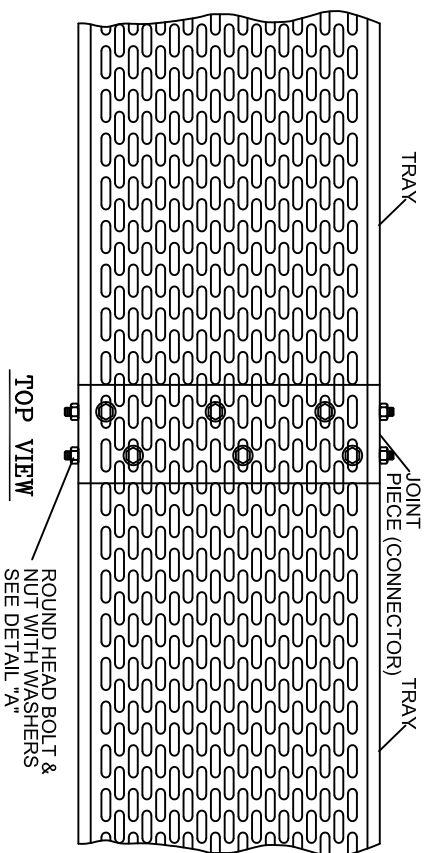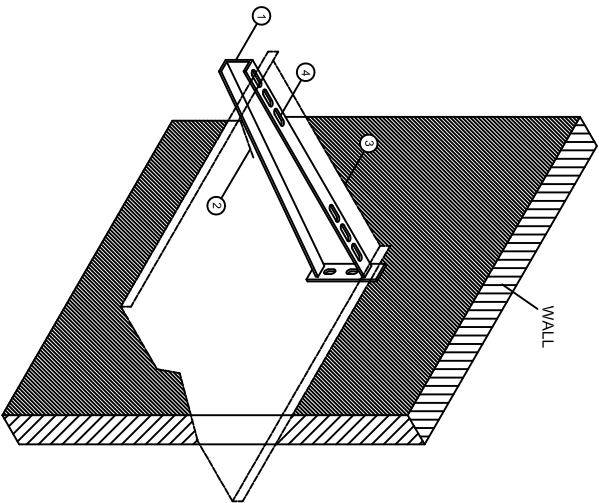

TITLE: BAGGED GOOD WAREHOUSE 2								
SCALE: AS SHOWN	DESIGNED							
DATE: 1405-06-09	CHECKED 1	S-HOSSEINI						
REF.:	CHECKED 2	-						
DRG.No.:	FINAL CHECK	N-ABBASI						
DRAWN: S-HOSSEINI	REVISIONS	A	B	C	1	2		
FILE CODE:		3	4	5	6	7		

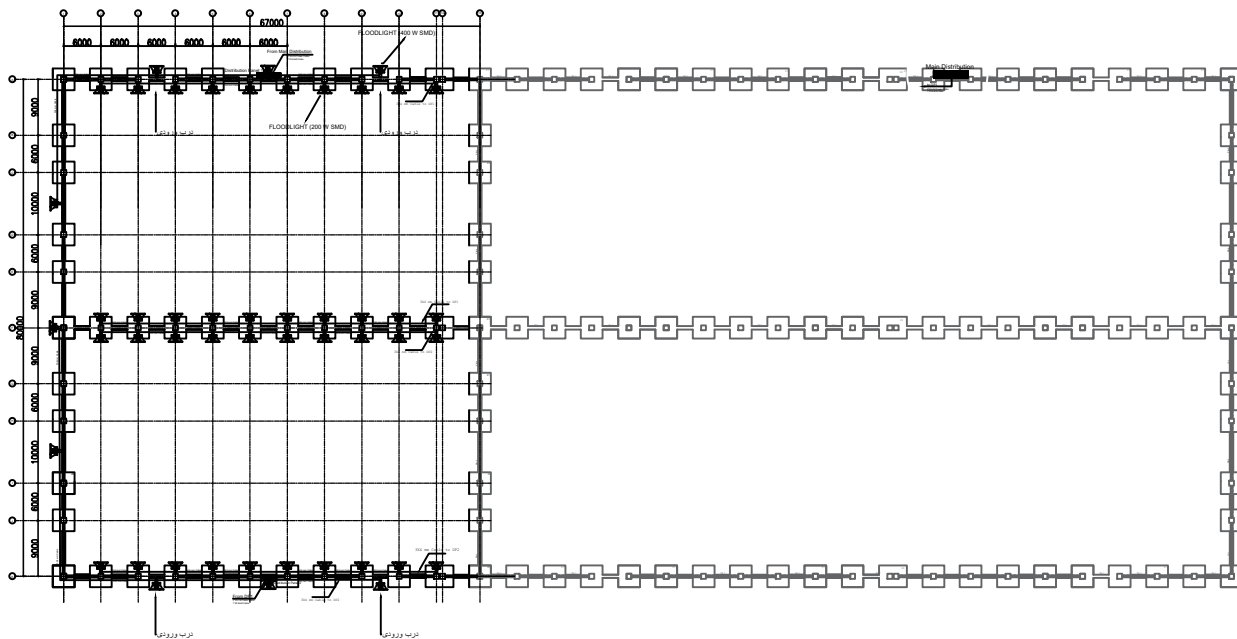


NOTES/DESCRIPTION		
	FLOODLIGHT (200 W SMD)	40
	FLOODLIGHT (400 W SMD)	9
	Distribution Panel	2

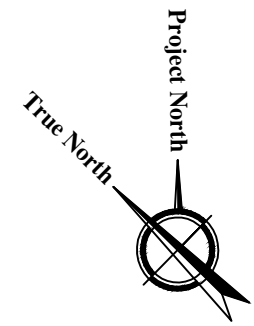


INSTALLATION DETAIL HALL LIGHTING SECTION

TITLE: BAGGED GOOD WAREHOUSE 2													
SCALE:	AS SHOWN	DESIGNED											
DATE:	1405-06-09	CHECKED 1	S-HOSSEINI										
REF.:		CHECKED 2	-										
DRG.No.:		FINAL CHECK	N-ABBASI										
DRAWN:	S-HOSSEINI	REVISIONS	<table><tr><td>A</td><td>B</td><td>C</td><td>1</td><td>2</td></tr><tr><td>3</td><td>4</td><td>5</td><td>6</td><td>7</td></tr></table>	A	B	C	1	2	3	4	5	6	7
A	B	C	1	2									
3	4	5	6	7									
FILE CODE:													

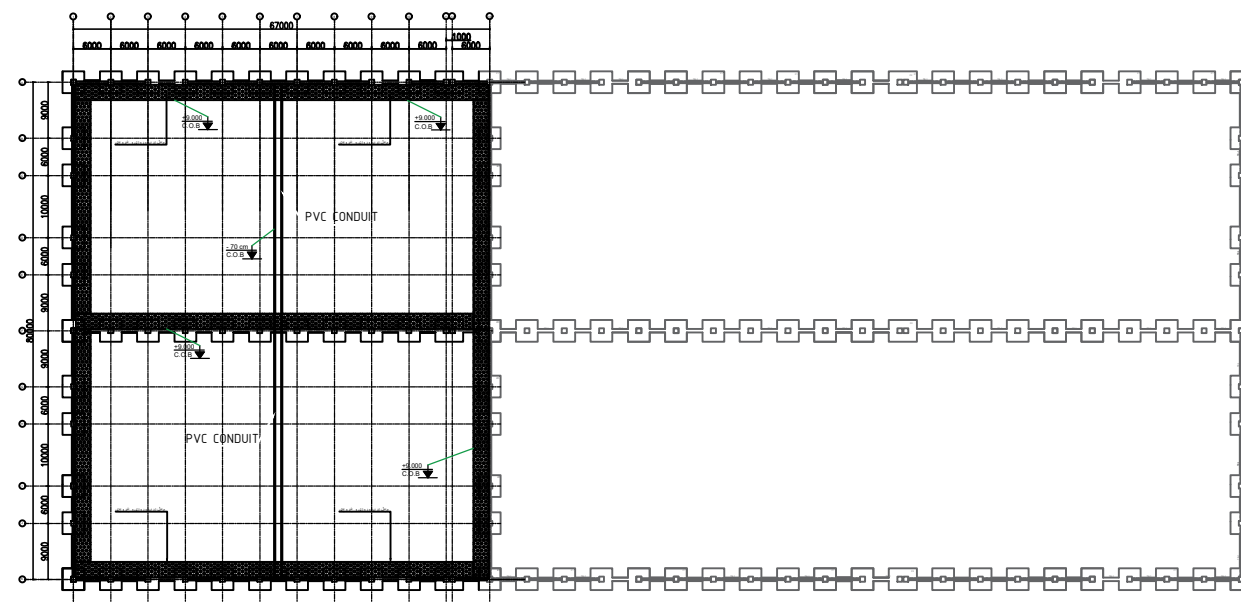


NOTES/DESCRIPTION		
	Cable Tray 30 CM	350 m
	PVC CONDUIT 110	200 m

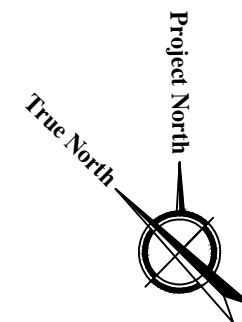

TITLE: BAGGED GOOD WAREHOUSE 2													
SCALE:	AS SHOWN	DESIGNED											
DATE:	1405-06-09	CHECKED 1	S-HOSSEINI										
REV.:		CHECKED 2	-										
ENG.No.:		FINAL CHECK	N-ABBASI										
DRAWN:	S-HOSSEINI	REVISIONS	<table><tr><td>A</td><td>B</td><td>C</td><td>1</td><td>2</td></tr><tr><td>3</td><td>4</td><td>5</td><td>6</td><td>7</td></tr></table>	A	B	C	1	2	3	4	5	6	7
A	B	C	1	2									
3	4	5	6	7									
FILE CODE:													

INSTALLATION DETAIL WALL MOUNTED CABLE TRAY

TITLE: BAGGED GOOD WAREHOUSE 2			
SCALE:	AS SHOWN	DESIGNED	
DATE:	1405-06-09	CHECKED 1	
REF.:		CHECKED 2	
DRG.No.:		FINAL CHECK	
DRAWN:	S-HOSSEINI	REVISIONS	
FILE CODE:			

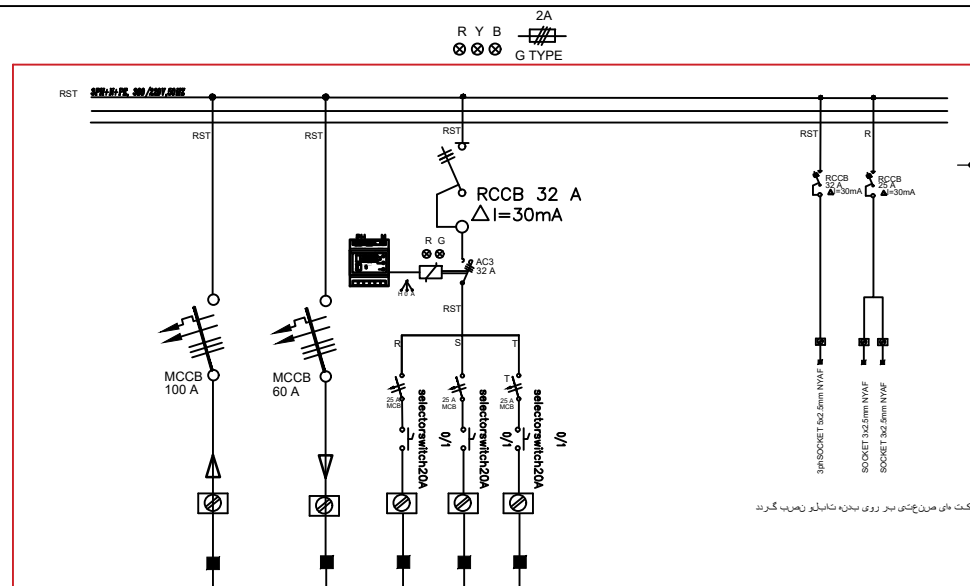


TERMINAL NO.	0	1(R)	2(S)	3(T)
CIRCUIT NO.	0	P1	P2	P3
POWER(C.L)---(W)		2000	2000	800
CONDUCTOR	SIZE (mm2)	3*50+25	3*25+16	3x4
	TYPE	N2XY	N2XY	NYN
CONDUIT	SIZE (mm)	300*100(cable tray)	110	cable tray
	TYPE	GALVANIZED	pvc pipe	GALVANIZED
TERMINAL	SIZE (mm2)	-	6	6
DESCRIPTION	FROM Main Distribution	to Distribution panel2	LIGHTING	LIGHTING

Distribution Panel 1


* Installation outside the warehouse shed *

TITLE: BAGGED GOOD WAREHOUSE 2			
SCALE:	AS SHOWN	DESIGNED	
DATE:	1406-06-09	CHECKED 1	
REF.:		CHECKED 2	
DWG.No.:		FINAL CHECK	
DRAWN:	S-HOSSEINI	REVISIONS	A B C 1 2 3 4 5 6 7
FILE CODE:			

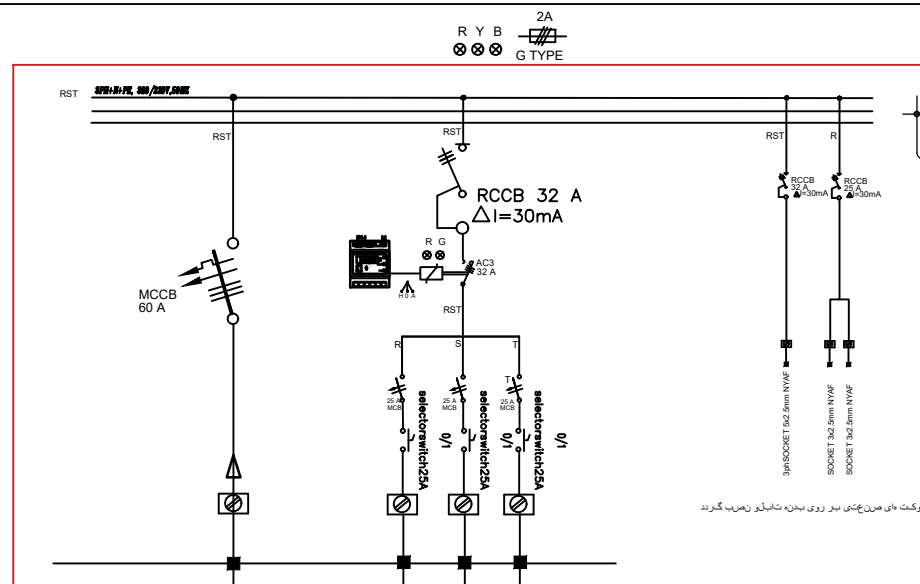


TERMINAL NO.	0	1(R)	2(S)	3(T)
CIRCUIT NO.	0	P1	P2	P3
POWER(C.L)---(W)		2000	2000	1000
CONDUCTOR	SIZE (mm2) TYPE	2(3*25+16) NYN	3x4	3x4
CONDUIT	SIZE (mm) TYPE		cable try GALVANIZED	cable try GALVANIZED
TERMINAL	SIZE (mm2)	6	6	6
DESCRIPTION	FROM Distribution panel 1			
		LIGHTING	LIGHTING	LIGHTING

Distribution Panel 2 * Installation outside the warehouse shed *

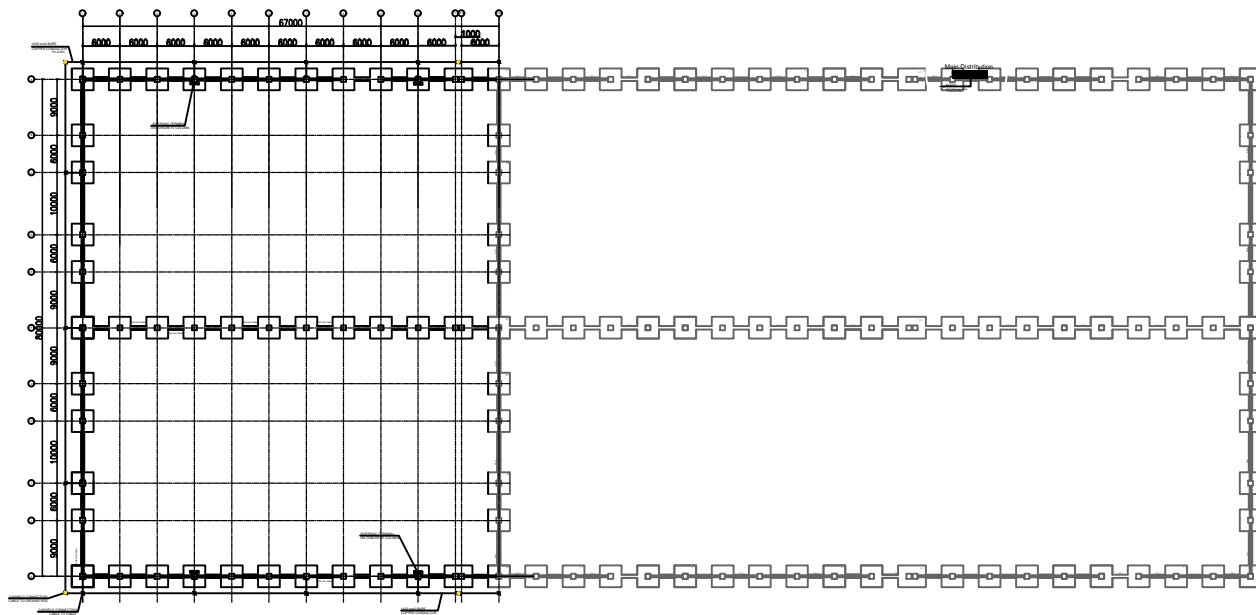

NOTES/DESCRIPTION		
	FLOODLIGHT (200 W SMD)	49
	Distribution Panel	2

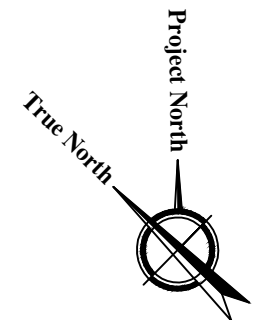

INSTALLATION DETAIL HALL LIGHTING SECTION

TITLE:		BAGGED GOOD WAREHOUSE 2		
SCALE:	AS SHOWN	DESIGNED		
DATE:	1406-06-09	CHECKED 1	S-HOSSEINI	
REF.:		CHECKED 2	-	
DRG.No.:		FINAL CHECK	N-ABBASI	
DRAWN:	S-HOSSEINI	REVISIONS	A B C 1 2 3 4 5 6 7	
FILE CODE:				